


## Area of Potential Visibility from the Proposed 115kV Line

DPS-DR-7

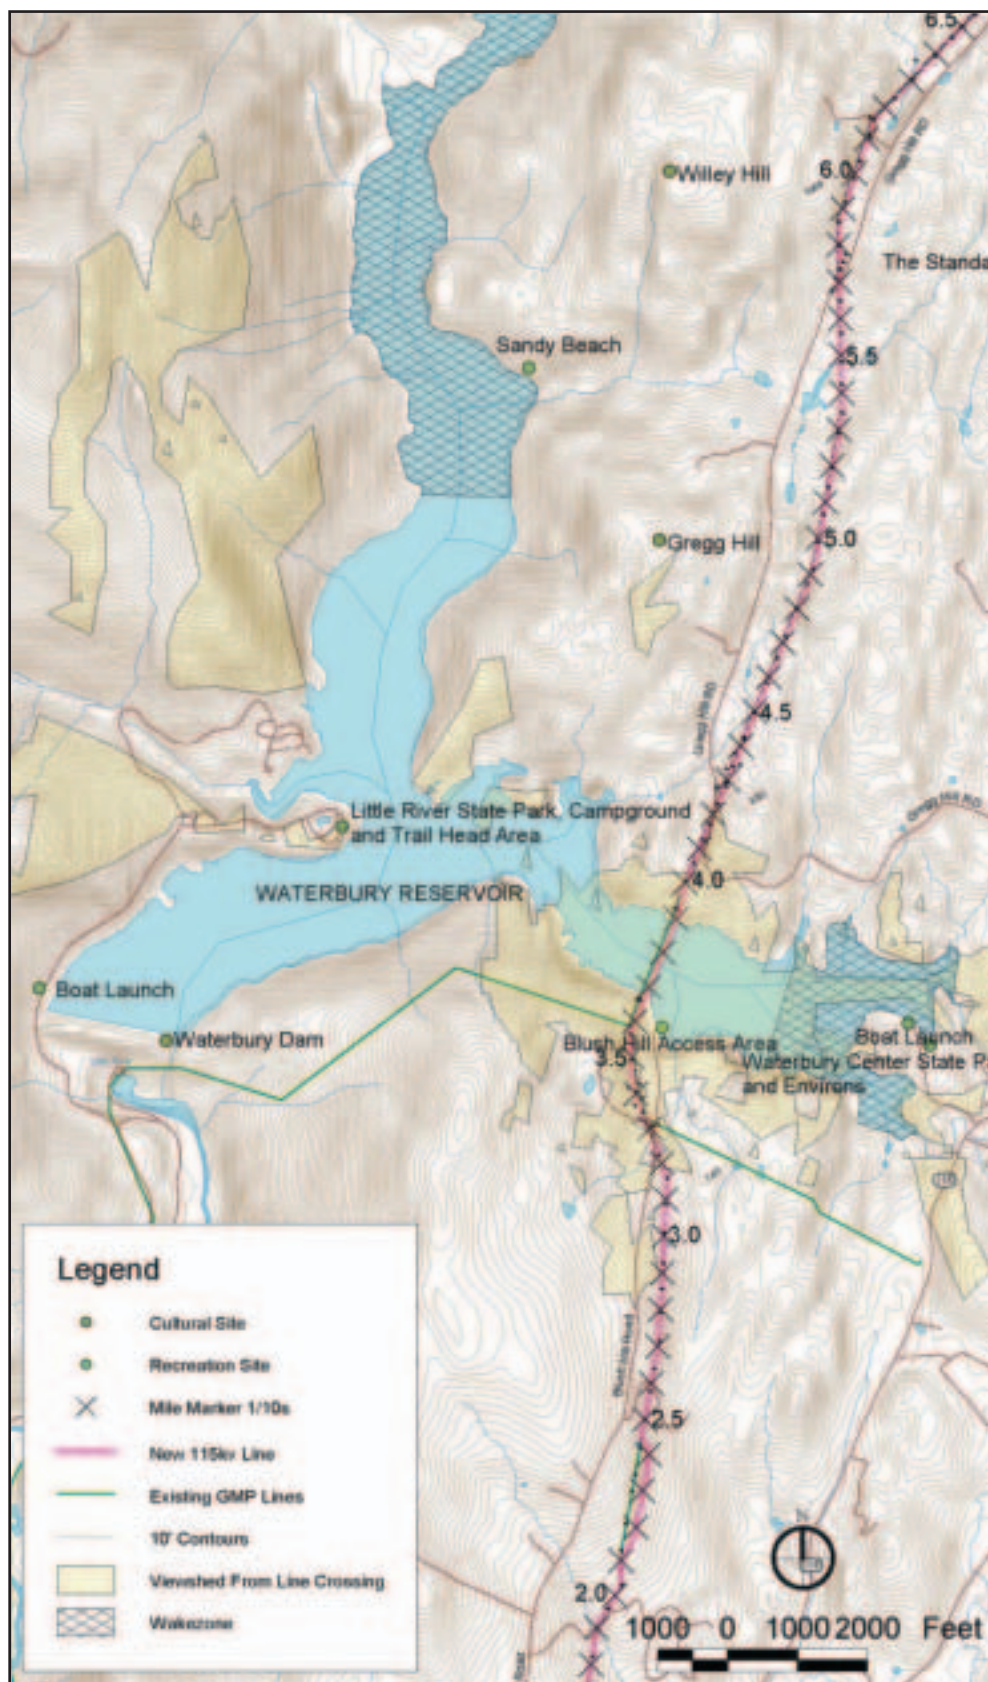

## Area of Potential Visibility from the Proposed Cuts

DPS-DR-8

